

## Detect Free Water in Diesel Fuel


### FEATURES

- **Easy to Use** – Automatically controls the sample size. Simple evaluation by color comparison.
- **Shelf Life** – For details on shelf life refer to date on box or contact Velcon at 1-800-531-0180.
- **Responds Consistently** – Responds consistently in a wide variety of undyed diesel fuels.
- **Carefully Controlled Quality** – Manufactured by Velcon Filters to strict quality control specifications.

### DESCRIPTION

The HYDROKIT<sup>®</sup> is an effective “Go, No-Go” field test designed to periodically check for free water, which is removed to ppm levels by properly operating filter/ separators, **Aquacon**<sup>®</sup>, and monitor vessels. Samples are normally taken downstream of the vessel, but they can also be taken at other points in the fuel distribution system.

The HYDROKIT<sup>®</sup> is designed to indicate free water in excess of 200 ppm by changing the powder contained in the sample tube to a pink color. Other concentrations can be estimated using the other colors on the card. The HYDROKIT<sup>®</sup> provides better water determination than ASTM D2709 or D4176. The HYDROKIT<sup>®</sup> is designed for “fail-safe” operation, with false negative readings unlikely. Almost any error in performing the test will indicate the presence of wet fuel. If the sample indicates the presence of excessive water, it is always a good practice to repeat the test on a second sample.

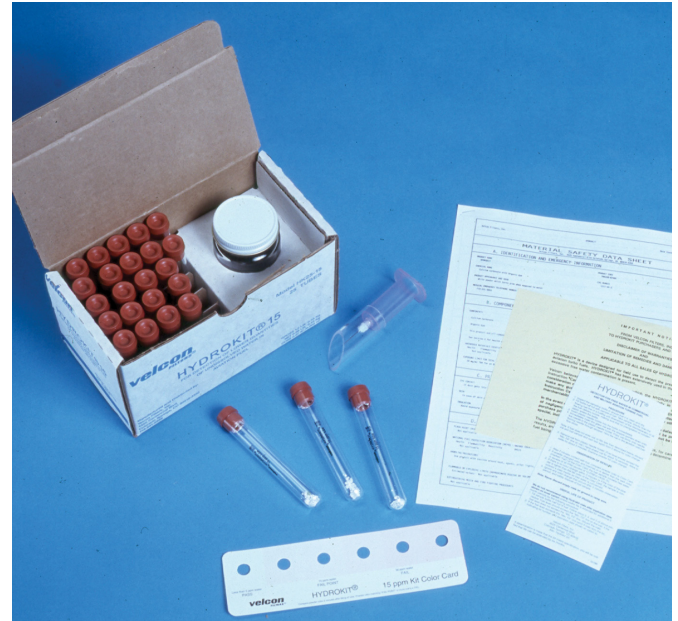

### APPLICATIONS

- Diesel Fuel, undyed
- Not for use with Avgas

### ORDERING INFORMATION

| <u>MODEL NO.</u> | <u>QTY OF TEST TUBES</u> |
|------------------|--------------------------|
| HKD25            | 25                       |

Each model above comes complete with:  
sample tubes  
wide mouth glass sample jar(s)  
needle holder assembly  
instruction card  
color indicator comparison card

# How To Use HYDROKIT®

**1**  
Sample bottle must be clean.



**2**  
Take sample downstream of vessel.




**3**  
Push tube down into needle holder in sample.





**4**  
After tube fills, shake for 15 seconds. Set upright to allow powder to settle.



**5** Check powder color at one minute.

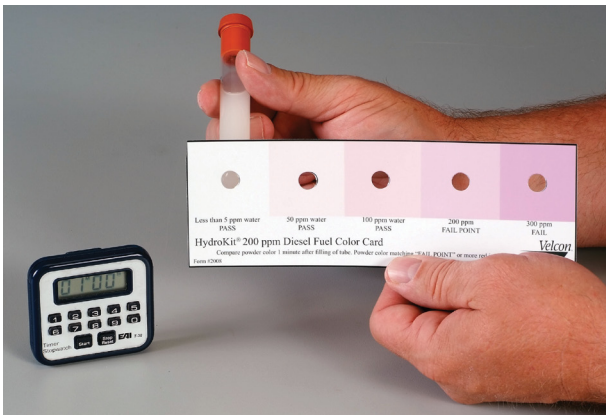

**6** If color is the same or darker than FAIL, more than 200 ppm of free water is present.

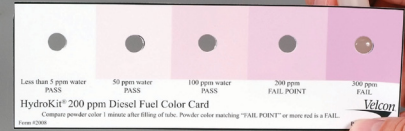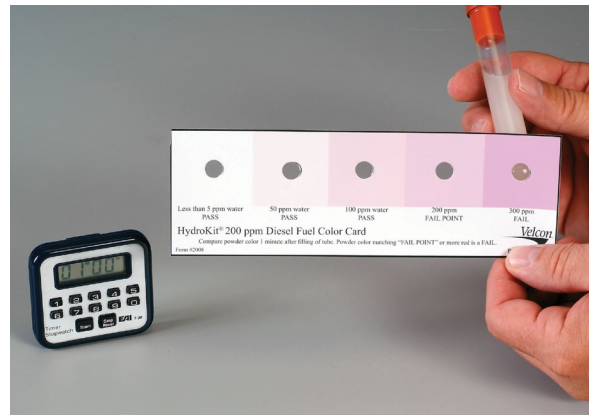

Velcon products are sold and serviced by a world-wide representative network. To order, contact Headquarters or your LOCAL REPRESENTATIVE:

COMPANY HEADQUARTERS:  
Velcon Filters, LLC  
1210 Garden of the Gods Road  
Colorado Springs, CO 80907-3410  
Phone: 1.800.531.0180 / 1.719.531.5855  
Fax: 719.531.5690  
e-mail: vfsales@velcon.com  
www.velcon.com

MANUFACTURING PLANTS LOCATED AT:  
Colorado Springs, Colorado  
Sylacauga, Alabama  
Henryetta, Oklahoma

OFFICES AND AFFILIATES IN:  
Canada, Germany, Singapore, & Spain



**Liquid Filtration  
and Separation  
Specialists**